



City of
LA PALMA
Community Services
Department

LET'S GET
SMART ABOUT **WATER**



DATA FOR 2015

2016 Water Quality Report



Your 2016 Water Quality Report

Since 1990, California public water utilities have been providing an annual Water Quality Report to their customers. **This year's report covers calendar year 2015 drinking water quality testing and reporting.**

Your City of La Palma Community Services Department (City) vigilantly safeguards its water supply and, as in years past, the water delivered to your home meets the quality standards required by federal and state regulatory agencies. The U.S. Environmental Protection Agency (USEPA) and the State Water Resources Control Board, Division of Drinking Water (DDW) are the agencies responsible for establishing and enforcing drinking water quality standards. In some cases, the City goes beyond what is required by testing for unregulated chemicals that may have known health risks but do not have drinking water standards. For example, the Orange County Water District (OCWD),



which manages the ground water basin, and the Metropolitan Water District of Southern California (MWDSC), which supplies treated imported surface water to the City, both test for unregulated chemicals in our water supply. Unregulated chemical monitoring helps USEPA and DDW determine where certain chemicals occur and whether new standards need to be established for those chemicals to protect public health.

Through drinking water quality testing programs carried out by OCWD for groundwater and the City for the water distribution system, your drinking water is constantly monitored from source to tap for regulated and unregulated contaminants.

The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Some of our data, though representative, is more than one year old.

The Quality of Your Water is Our Primary Concern

Sources of Supply

Orange County's water supplies are a blend of groundwater managed by the Orange County Water District (OCWD) and water imported from Northern California and the Colorado River by the Municipal Water District of Orange County (MWDOC) via Metropolitan Water District of Southern California (MWDSC). Groundwater comes from a natural underground aquifer that is replenished with water from the Santa Ana River, local rainfall, and imported water. The groundwater basin is 350 square miles and lies beneath north and central Orange County from Irvine to the Los Angeles County border and from Yorba Linda to the Pacific Ocean. More than 20 cities and retail water districts draw from the basin to provide water to homes and businesses.

Orange County's Water Future

For years, Orange County has enjoyed an abundant, seemingly endless supply of high-quality water. However, as water demand continues to increase statewide, we must be even more conscientious about our water supply and maximize the efficient use of this precious natural resource.

OCWD and MWDOC work cooperatively to evaluate new and innovative water management and supply development programs, including water reuse and recycling, wetlands expansion, recharge facility construction, ocean and brackish water desalination, surface storage and water use efficiency programs. These efforts are helping to enhance long-term countywide water reliability and water quality.

A healthy water future for Orange County rests on finding and developing new water supplies, as well as protecting and improving the quality of the water that we have today. Your local and regional water agencies are committed to making the necessary investments today in new water management projects to ensure an abundant and high-quality water supply for our future.



Basic Information About Drinking Water Contaminants

The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of land or through the layers of the ground it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animal and human activity.

Contaminants that may be present in source water include:

- **Microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- **Radioactive contaminants**, which can be naturally occurring or be the result of oil and gas production or mining activities.
- **Inorganic contaminants**, such as salts and metals, which can be naturally occurring or result from urban storm runoff, industrial or domestic wastewater discharges, oil and gas production, mining, and farming.
- **Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- **Organic chemical contaminants**, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gasoline stations, urban stormwater runoff, agricultural application, and septic systems.

In order to ensure that tap water is safe to drink, USEPA and the DDW prescribe regulations that limit the amount of certain contaminants in water provided by public

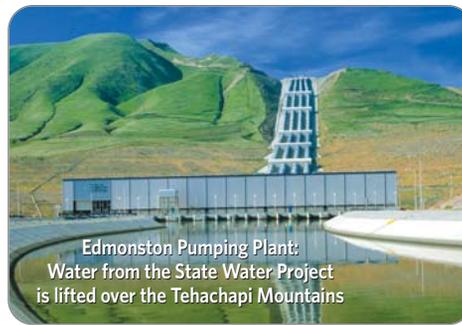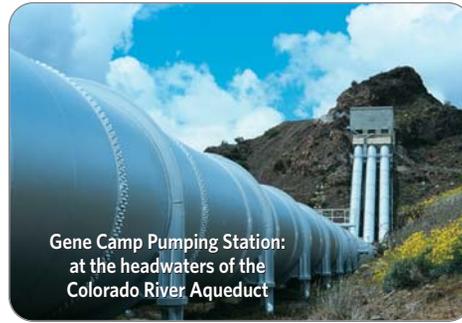

water systems. DDW regulations also establish limits for contaminants in bottled water that must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at (800) 426-4791.

Drinking Water Fluoridation

Fluoride has been added to U.S. drinking water supplies since 1945. Of the 50 largest cities in the U.S., 43 fluoridate their drinking water. In December 2007, the MWDSC joined a majority of the nation's public water suppliers in adding fluoride to drinking water in order to prevent tooth decay. In line with recommendations from the CDPH, as well as the U.S. Centers for Disease Control and Prevention, MWDSC adjusted the natural fluoride level in imported treated water from the Colorado River and State Water

Project to the optimal range for dental health of 0.6 to 1.2 parts per million. Our local water is not supplemented with fluoride. Fluoride levels in drinking water are limited under California state regulations at a maximum dosage of 2 parts per million.

There are many places to go for additional information about the fluoridation of drinking water.

U.S. Centers for Disease Control and Prevention: www.cdc.gov/fluoridation/
State Water Resources Control Board, Division of Drinking Water

www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation.shtml

For more information about MWDSC's fluoridation program, please contact Edgar G. Dymally at (213) 217-5709 or at edymally@mwdh2o.com.

Conservation Tips for Inside Your Home

Soak pots and pans instead of letting water run while you scrub them clean

Saves water and makes the job easier

Cook food in as little water as possible

Saves water and helps retain food nutrients

Keep a pitcher of drinking water in the refrigerator

Saves gallons of water and it's always cold

Wash only full loads of laundry and dishes: **Saves up to 50 gallons per week**

Buy water-saving devices like high-efficiency toilets and clothes washers. You'll save many gallons of water per day, and many of them are eligible for rebates.

To learn more, visit: www.ocwatersmart.com.



Questions about your water? Contact us for answers.

For information about this report, or your water quality in general, please contact the Community Services Department at (714) 690-3310.

The City Council meets on the 1st and 3rd Tuesday of every month at 7:00 p.m. in the City Council Chambers located at 7822 Walker Street, La Palma, CA 90623. Please feel free to participate in these meetings.

For more information about the health effects of the listed contaminants in the following tables, call the USEPA hotline at (800) 426-4791.

Important Information the EPA Would Like You to Know

Issues in Water Quality that Could Affect Your Health

About Lead in Tap Water

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children.

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components.



When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking.

If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or on the internet at: www.epa.gov/safewater/lead.

What are Water Quality Standards?

Drinking water standards established by USEPA and DDW set limits for substances that may affect consumer health or aesthetic qualities of drinking water. The chart in this report shows the following types of water quality standards:

- **Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible.
- **Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- **Secondary MCLs:** Set to protect the odor, taste, and appearance of drinking water.
- **Primary Drinking Water Standard:** MCLs for contaminants that affect health along with their monitoring and reporting requirements and water treatment requirements.
- **Regulatory Action Level (AL):** The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements that a water system must follow.

How are Contaminants Measured?

Water is sampled and tested throughout the year. Contaminants are measured in:

- parts per million (ppm) or milligrams per liter (mg/L)
- parts per billion (ppb) or micrograms per liter (µg/L)
- parts per trillion (ppt) or nanograms per liter (ng/L)

What is a Water Quality Goal?

In addition to mandatory water quality standards, USEPA and DDW have set voluntary water quality goals for some contaminants. Water quality goals are often set at such low levels that they are not achievable in practice and are not directly measurable. Nevertheless, these goals provide useful guideposts and direction for water management practices. The chart in this report includes three types of water quality goals:

- **Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by USEPA.
- **Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- **Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Immunocompromised People

Some people may be more vulnerable to contaminants in drinking water than the general population.

Immunocompromised people, such as those with cancer who are undergoing chemotherapy, persons who have had organ transplants, people with HIV/AIDS or other immune system disorders, some elderly persons, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers.

Disinfectants and Disinfection Byproducts

Disinfection of drinking water was one of the major public health advances in the 20th century. Disinfection was a major factor in reducing waterborne disease

epidemics caused by pathogenic bacteria and viruses, and it remains an essential part of drinking water treatment today.

Chlorine disinfection has almost completely eliminated from our lives the risks of microbial waterborne diseases. Chlorine is added to your drinking water at the source of supply (groundwater well). Enough chlorine is added so that it does not completely dissipate through the distribution system pipes. This "residual" chlorine helps to prevent the growth of bacteria in the pipes that carry drinking water from the source into your home.

However, chlorine can react with naturally-occurring materials in the water to form unintended chemical byproducts, called disinfection byproducts (DBPs), which may pose health risks. A major challenge is how to

2015 City of La Palma Drinking Water Quality Local Groundwater and Imported Metropolitan Water District Treated Surface Water

Chemical	MCL	PHG (MCLG)	Avg. Groundwater Amount	Avg. Imported MWD Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
Radiologicals – Tested in 2014							
Alpha Radiation (pCi/L)	15	(0)	ND	ND	ND – 4	No	Erosion of Natural Deposits
Beta Radiation (pCi/L)	50	(0)	NR	5	4 – 6	No	Decay of Man-made or Natural Deposits
Uranium (pCi/L)	20	0.43	<1	3	ND – 3	No	Erosion of Natural Deposits
Inorganic Chemicals – Tested in 2014 and 2015							
Aluminum (ppm)	1	0.6	ND	0.155	ND – 0.24	No	Erosion of Natural Deposits
Arsenic (ppb)	10	0.004	7.8	2.3	2.3 – 10.7	No	Erosion of Natural Deposits
Fluoride (ppm) – naturally-occurring	2	1	0.42	NR	0.39 – 0.45	No	Erosion of Natural Deposits
Fluoride (ppm) treatment-related	Control Range 0.6 – 1.2 ppm Optimal Level 0.7 ppm		NR	0.8	0.6 – 1	No	Water Additive for Dental Health
Secondary Standards* – Tested in 2014 and 2015							
Aluminum (ppb)	200*	600	ND	155	ND – 240	No	Erosion of Natural Deposits
Chloride (ppm)	500*	n/a	16.7	100	14 – 101	No	Runoff or Leaching from Natural Deposits
Color (color units)	15*	n/a	ND	1	ND – 1	No	Runoff or Leaching from Natural Deposits
Manganese (ppb)	50*	n/a	50.6	ND	ND – 54.8	No	Erosion of Natural Deposits
Odor (odor units)	3*	n/a	<1	2	ND – 2	No	Naturally-occurring Organic Materials
Specific Conductance (µmho/cm)	1,600*	n/a	488	1,040	470 – 1,040	No	Substances that Form Ions in Water
Sulfate (ppm)	500*	n/a	51.8	257	45.3 – 261	No	Runoff or Leaching from Natural Deposits
Total Dissolved Solids (ppm)	1,000*	n/a	295	663	284 – 665	No	Runoff or Leaching from Natural Deposits
Turbidity (NTU)	5*	n/a	0.2	ND	ND – 0.2	No	Runoff or Leaching from Natural Deposits
Unregulated Chemicals – Tested in 2014 and 2015							
Alkalinity, total (ppm as CaCO ₃)	Not Regulated	n/a	175	126	120 – 175	n/a	Runoff or Leaching from Natural Deposits
Boron (ppm)	NL = 1	n/a	<0.1	0.12	ND – 0.12	n/a	Runoff or Leaching from Natural Deposits
Calcium (ppm)	Not Regulated	n/a	43.7	78	43.4 – 80	n/a	Runoff or Leaching from Natural Deposits
Hardness, total (ppm)	Not Regulated	n/a	148	303	144 – 306	n/a	Runoff or Leaching from Natural Deposits
Hardness, total (grains/gal)	Not Regulated	n/a	8.68	17.8	8.44 – 17.9	n/a	Runoff or Leaching from Natural Deposits
Magnesium (ppm)	Not Regulated	n/a	9.3	27	8.6 – 27	n/a	Runoff or Leaching from Natural Deposits
pH (pH units)	Not Regulated	n/a	8.1	8.1	8.1	n/a	Hydrogen Ion Concentration
Potassium (ppm)	Not Regulated	n/a	2.1	4.9	2 – 5	n/a	Runoff or Leaching from Natural Deposits
Sodium (ppm)	Not Regulated	n/a	49.3	101	47.1 – 104	n/a	Runoff or Leaching from Natural Deposits
Total Organic Carbon (ppm)	TT	n/a	ND	2.6	ND – 2.7	n/a	Various Natural and Man-made Sources

ppb = parts-per-billion; ppm = parts-per-million; pCi/L = picoCuries per liter; NTU = nephelometric turbidity units; µmho/cm = micromhos per centimeter; NR = Not Required to be analyzed; ND = not detected; < = average is less than the detection limit for reporting purposes; MCL = Maximum Contaminant Level; (MCLG) = federal MCL Goal; PHG = California Public Health Goal; NL = Notification Level; n/a = not applicable *Contaminant is regulated by a secondary standard.

Turbidity – combined filter effluent	Treatment Technique	Turbidity Measurements	TT Violation?	Typical Source of Contaminant
Metropolitan Water District Diemer Filtration Plant				
1) Highest single turbidity measurement	0.3 NTU	0.04	No	Soil Runoff
2) Percentage of samples less than 0.3 NTU	95%	100%	No	Soil Runoff

Turbidity is a measure of the cloudiness of the water, an indication of particulate matter, some of which might include harmful microorganisms. Low turbidity in Metropolitan's treated water is a good indicator of effective filtration. Filtration is called a "treatment technique" (TT). A treatment technique is a required process intended to reduce the level of contaminants in drinking water that are difficult and sometimes impossible to measure directly.

Unregulated Chemicals Requiring Monitoring

Chemical	Notification Level	PHG	Average Groundwater	Average Imported MWD Water	Range of Detections	Most Recent*** Sampling Date
Chlorate (ppb)	800	n/a	120	68	64 – 170	2013
Chromium, Hexavalent (ppb)**	MCL = 10	0.02	ND	0.06	ND – 0.06	2013
Molybdenum, Total (ppb)	n/a	n/a	16	4.5	4.5 – 19	2013
Strontium, Total (ppb)	n/a	n/a	530	900	490 – 900	2013
Vanadium, Total (ppb)	50	n/a	<0.2	2.9	ND – 2.9	2013

**Hexavalent chromium is regulated with an MCL of 10 ppb but was not detected, based on the detection limit for purposes of reporting of 1 ppb. Hexavalent chromium was included as part of the unregulated chemicals requiring monitoring.

***The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.

balance the risks from microbial pathogens and DBPs. It is important to provide protection from these microbial pathogens while simultaneously ensuring decreasing health risks from disinfection byproducts. The Safe Drinking Water Act requires the USEPA to develop rules to achieve these goals.

Trihalomethanes (THMs) and Haloacetic Acids (HAAs) are the most common and most studied DBPs found in drinking water treated with chlorine. In 1979, the USEPA set the maximum amount of total THMs allowed in drinking water at 100 parts per billion as an annual running average. Effective in January 2002, the Stage 1 Disinfectants / Disinfection Byproducts Rule lowered the total THM maximum annual average level to 80 parts per billion and added HAAs to the list of regulated chemicals in drinking water. Your drinking water complies with the Stage 1 Disinfectants / Disinfection Byproducts Rule.

Stage 2 of the regulation was finalized by USEPA in 2006, which further controls allowable levels of DBPs in drinking water without compromising disinfection itself. A required distribution system evaluation was completed in 2008 and a Stage 2 monitoring plan has been approved by DDW. Full Stage 2 compliance began in 2012.

Arsenic Advisory

While your drinking water meets the federal and state standard for arsenic of 10 micrograms per liter, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the cost of removing arsenic from drinking water. The USEPA continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage

Useful Water Conservation Tips for Outside Your Home

Check your sprinkler system and correct for overspray
Saves 12-15 gallons each time you water

Choose drip irrigation for your trees and shrubs
Saves up to 15 gallons each time you water



Use a broom instead of a hose
It takes very little time to sweep and the water savings add up

Plant drought-resistant trees and plants
Saves about 30-60 gallons per 1,000 sq. ft. each time you water

Water plants in the early morning
Reduces evaporation and ensures deeper watering

Use organic mulch around trees and plants to reduce evaporation, improve the soil, and prevent weeds
Saves about 20-30 gallons per 1,000 sq. ft. each time you water

Additional water saving steps and devices are also available, and some of these are eligible for substantial rebates. Also, water your garden deeply to promote healthier, stronger plants. Regular pruning will help your plants use water more efficiently.

For complete rebate information for these water saving resources, visit: www.ocwatersmart.com.

and circulatory problems. Additional information on arsenic is available from the EPA website, www.epa.gov/safewater/arsenic.

Cryptosporidium

Cryptosporidium is a microscopic organism that, when ingested, can cause diarrhea, fever, and other gastrointestinal symptoms. The organism comes from animal and/or human wastes and may be in surface water.

MWDSC tested their source water and treated surface water for *Cryptosporidium* in 2015 but did not detect it. If it ever is detected, *Cryptosporidium* is eliminated by an effective treatment combination including sedimentation, filtration and disinfection.

The USEPA and the federal Centers for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from USEPA's Safe Drinking Water Hotline at (800) 426-4791 between 10 a.m. and 4 p.m. Eastern Time (7 a.m. to 1 p.m. in California).

Want Additional Information?

There's a wealth of information on the internet about Drinking Water Quality and water issues in general. A good place to begin your own research is the City of La Palma website:

www.CityofLaPalma.org.

In addition to extensive information about your local water and the support and services we offer, you'll find links for many other local, statewide, and national resources.

Source Water Assessments

Imported (MWDSC) Water Assessment

Every five years, MWDSC is required by DDW to examine possible sources of drinking water contamination in its State Water Project and Colorado River source waters.

In 2012, MWDSC submitted to DDW its updated Watershed Sanitary Surveys for the Colorado River and State Water Project, which include suggestions for how to better protect these source waters. Both source waters are exposed to stormwater runoff, recreational activities, wastewater discharges, wildlife, fires, and other watershed-related factors that could affect water quality.

Water from the Colorado River is considered to be most vulnerable to contamination from recreation, urban/stormwater runoff, increasing urbanization in the watershed, and wastewater. Water supplies from Northern California's State Water Project are most vulnerable to contamination from urban/stormwater runoff, wildlife, agriculture, recreation, and wastewater.

USEPA also requires MWDSC to complete one Source Water Assessment (SWA) that utilizes information collected in the watershed sanitary surveys. MWDSC completed its SWA in December 2002. The SWA is used to evaluate the vulnerability of water sources to contamination and helps determine whether more protective measures are needed.

A copy of the most recent summary of either the Watershed Sanitary Survey or the SWA can be obtained by calling MWDSC at (800) CALL-MWD (225-5693).

Groundwater Assessment

An assessment of the drinking water sources for the City was completed in December 2002. The groundwater sources are considered most vulnerable to the following activities not associated with detected contaminants: drinking water treatment plants, high density housing, motor pools, repair shops, storm drain discharge points, utility stations — maintenance areas, and water supply wells.

A copy of the complete assessment is available at State Water Resources Control Board, Division of Drinking Water, 605 W. Santa Ana Boulevard, Building 28, Room 325, Santa Ana, California 92701.

You may request a summary of the assessment by contacting the City at (714) 690-3310.

2015 City of La Palma Distribution System Water Quality

Aesthetic Quality	MCL (MRDL/MRDLG)	Average Amount	Range of Detections	MCL Violation?	Typical Source of Contaminant
Total Trihalomethanes (ppb)	80	19	2.3 – 38.5	No	Byproducts of chlorine disinfection
Haloacetic Acids (ppb)	60	4	ND – 12.4	No	Byproducts of chlorine disinfection
Chlorine Residual (ppm)	(4 / 4)	0.75	0.02 – 2.6	No	Disinfectant added for treatment
Aesthetic Quality					
Color (color units)	15*	0.29	ND – 15	No	Erosion of natural deposits
Odor (threshold odor number)	3*	1	1 – 2	No	Erosion of natural deposits
Turbidity (NTU)	5*	1.3	0.1 – 14	No	Erosion of natural deposits

Eight locations in the distribution system are tested quarterly for total trihalomethanes and haloacetic acids; five locations are tested weekly for color, odor and turbidity.

MRDL = Maximum Residual Disinfectant Level; MRDLG = Maximum Residual Disinfectant Level Goal

*Contaminant is regulated by a secondary standard to maintain aesthetic qualities (taste, odor, color).

Lead and Copper Action Levels at Residential Taps

Action Level (AL)	Public Health Goal	90 th Percentile Value	Sites Exceeding AL / Number of Sites	AL Violation?	Typical Source of Contaminant
Lead (ppb)	15	0.2	1 / 32	No	Corrosion of household plumbing
Copper (ppm)	1.3	0.3	0 / 32	No	Corrosion of household plumbing

Thirty-two residences were tested for lead and copper at-the-tap during 2015.

Lead was detected in one home, which exceeded the regulatory Action Level. Copper was detected in 25 homes; none exceeded the AL.

A regulatory AL is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Unregulated Chemicals Requiring Monitoring in the Distribution System

Chemical	Notification Level	PHG	Average Amount	Range of Detections	Most Recent*** Sampling Date
Chlorate (ppb)	800	n/a	140	93 – 170	2013
Chromium, Hexavalent (ppb)**	MCL = 10	0.02	< 0.03	ND – 0.05	2013
Molybdenum, Total (ppb)	n/a	n/a	12	6.8 – 14	2013
Strontium, Total (ppb)	n/a	n/a	600	490 – 900	2013
Vanadium, Total (ppb)	50	n/a	0.53	ND – 1.8	2013

**Hexavalent chromium is regulated with an MCL of 10 ppb but was not detected, based on the detection limit for purposes of reporting of 1 ppb. Hexavalent chromium was included as part of the unregulated chemicals requiring monitoring.

***The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.

We All Need to Be Water Wise All Year Long

One Average Rainy Season Does Not Overcome the Effects of Four Dry Years

Winter storms this year boosted California's largest reservoirs to their historically average levels, but other key reservoirs remain critically low as our historic drought keeps its grip on the state. One average season does not overcome the effects of four dry years, and rain and snowfall were well below average in Southern California. To learn more about the drought, or to find useful tips for how to conserve water, click the logos to visit:

bewaterwise.com® or **Save Our WATER** 


To learn about programs and devices that can help save water, along with information on rebates for these water saving resources, visit:

www.OCWaterSmart.com

To view a short YouTube video on multiple ways to conserve water, [click here](#).



The Colorado Aqueduct
 Imported water from the Colorado River travels over 240 miles to get to Orange County. Along the way, it is lifted over 1,600 feet by a series of five pumping plants. Shown here, the Gene Pumping Station near the Colorado River boosts the water over 300 feet. From there, it flows through a series of canals, pipes, tunnels, and siphons, across the Mojave Desert and beneath the San Jacinto Mountains, on its way to meet the needs of the people of Southern California. To view a short YouTube video on the construction and history of the Colorado Aqueduct, [click here](#).

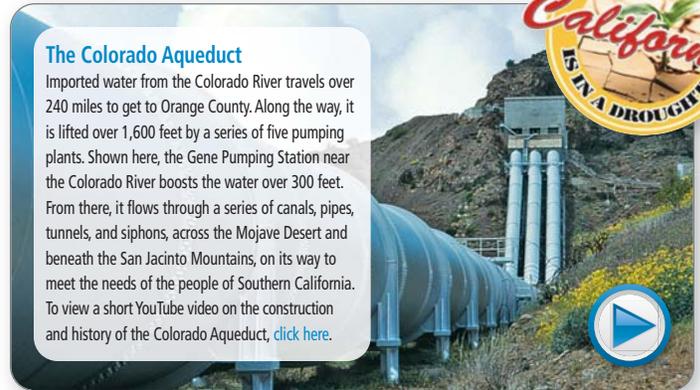

The California State Water Project
 The State Water Project, one of the largest water systems in the world, collects water from rivers in Northern California and transports it, through a network of canals, pipelines, and tunnels, over many hundreds of miles to Southern California, where it is distributed throughout the region. Along the way, it is lifted almost 3,800 feet, with the highest single lift of 1,926 feet over the Tehachapi Mountains, which separate the San Joaquin Valley from Southern California. To view a short YouTube video that shows the length and complexity of the State Water Project, [click here](#).



Conservation Tips for Inside Your Home . . .

Install aerators on the kitchen faucet

Reduces flow to less than 1 gallon per minute

Soak pots and pans instead of letting water run while you scrub them clean

Saves water and makes the job easier

Collect water used to wash fruits and vegetables

Use it to water your houseplants

Cook food in as little water as possible

Saves water and helps retain food nutrients

Keep a pitcher of drinking water in the refrigerator

Saves gallons of water and it's always cold

Wash only full loads of laundry and dishes

Saves up to 50 gallons per week

Plug the sink instead of running water to rinse your razor

Saves up to 300 gallons a month

Don't run water to thaw food:

Defrost in the refrigerator



We Use the Most Water in Our Homes on the Outside


Save the Most Where You Use the Most: Make Your Outdoor Use Efficient!

Outdoor watering of lawns and gardens makes up approximately 60% of home water use. By reducing your outdoor water use — by either cutting back on irrigation or planting more drought tolerant landscaping — you can dramatically reduce your overall water use.

For rebates on water saving devices, visit:

www.OCWaterSmart.com

How Residential Water is Used in Orange County

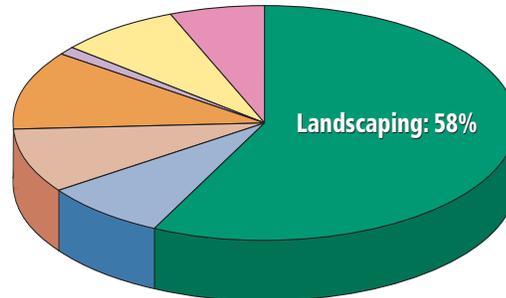

- Showers & Baths: 8%
- Clothes Washers: 9%
- Toilets: 11%
- Dishwashers: 1%
- Leaks: 7%
- Faucets: 6%

Data is representative of average consumption; your water usage may vary.

Tips for Conserving Water Outside Your Home. . .

Use a broom instead of a hose

It takes very little time to sweep and the water savings add up

Water plants in the early morning

Reduces evaporation and ensures deeper watering

Plant drought-resistant trees and plants

Saves about 30-60 gallons per 1,000 sq. ft. each time you water

Remove the turf from your yard:

Saves about 42 gallons per square foot/per year

Check your sprinkler system for leaks, overspray and broken sprinkler heads and repair promptly:

Saves 12-15 gallons each time you water

Use organic mulch around trees and plants to reduce evaporation and improve the soil

Saves about 20-30 gallons per 1,000 sq. ft. each time you water

Additional water saving steps and devices are also available, and some are eligible for substantial rebates. You should consider a cover for your swimming pool or hot tub to reduce evaporation. And water your garden deeply to promote healthier, stronger plants. Regular pruning will help your plants use water more efficiently. You won't need to water as often, either.

For complete rebate information for these water saving resources, visit: www.ocwatersmart.com.

***Talk to your family and friends about saving water.
If everyone does a little, we all benefit a lot.***



City of La Palma Community Services Department

7821 Walker Street • La Palma, California 90623
(714) 690-3300 • www.cityoflapalma.org

This report contains important information about your drinking water. Translate it, or speak with someone who understands it.

يحتوي هذا التقرير على معلومات هامة عن نوعية ماء الشرب في منطقتك. يرجى ترجمته، أو ابحث التقرير مع صديق لك يفهم هذه المعلومات جيدا.

Arabic

이 보고서에는 귀하가 거주하는 지역의 수질에 관한 중요한 정보가 들어 있습니다. 이것을 번역하거나 충분히 이해하시는 친구와 상의하십시오.

Korean

这份报告中有些重要的信息，讲到关于您所在社区的水的品质。请您找人翻译一下，或者请能看得懂这份报告的朋友给您解释一下。

Chinese

Este informe contiene información muy importante sobre su agua potable. Para mas información ó traducción, favor de contactar a Customer Service Representative. Telefono: (714) 690-3310.

Spanish

この資料には、あなたの飲料水についての大切な情報が書かれています。内容をよく理解するために、日本語に翻訳して読むか説明を受けてください。

Japanese

Bản báo cáo có ghi những chi tiết quan trọng về phẩm chất nước trong cộng đồng quý vị. Hãy nhờ người thông dịch, hoặc hỏi một người bạn biết rõ về vấn đề này.

Vietnamese